


CORONA SHIELD CONSISTS OF RING SUPPORTED AS SHOWN
BY RODS PLACED FAR ENOUGH APART TO ALLOW SERVICING
AND REPLACING LIGHT FIXTURE


TOP OF CORONA SHIELD SHOULD
BE 1 FOOT ABOVE TOP OF BEACON

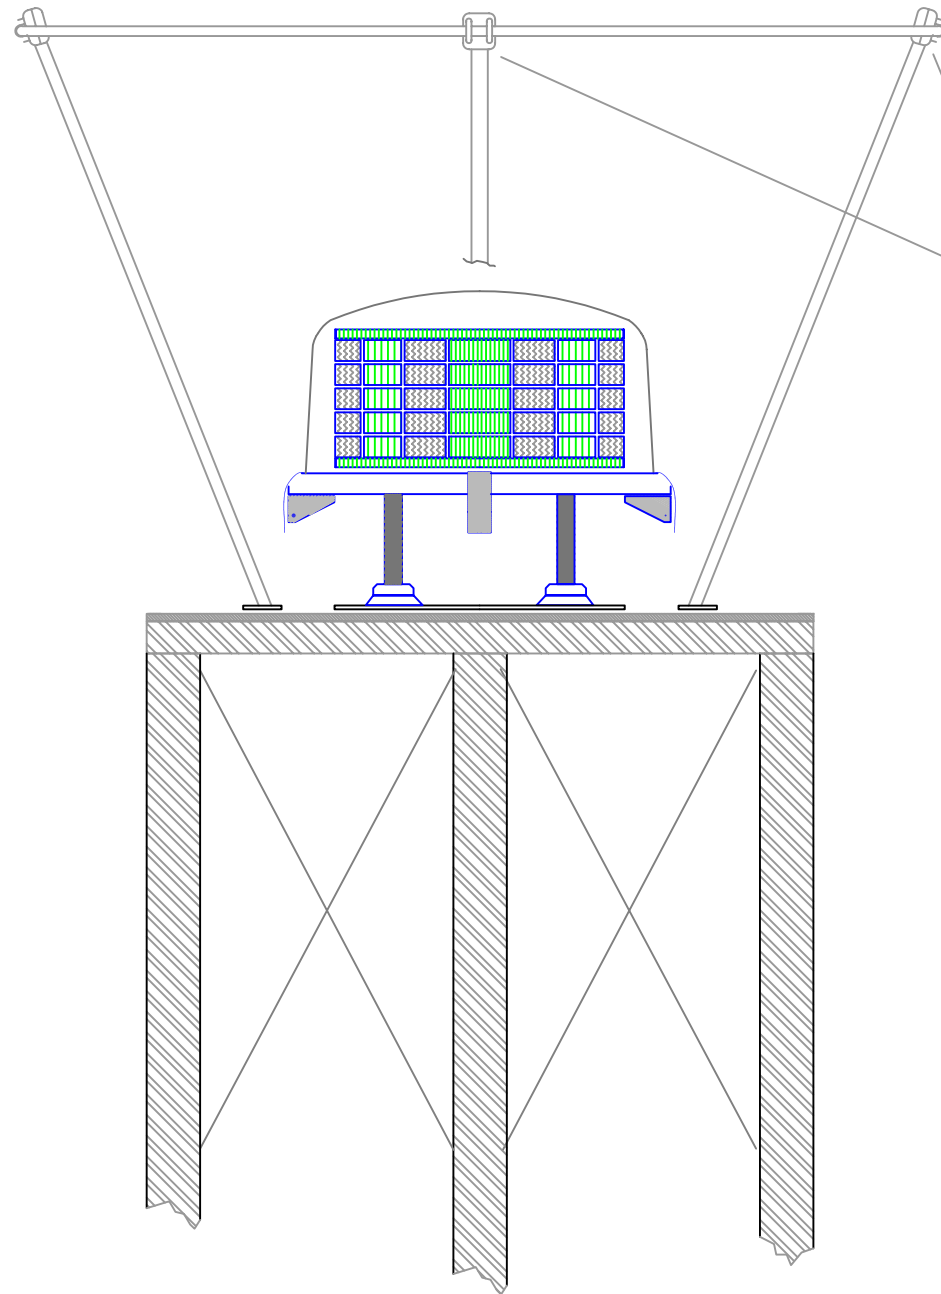

CONNECTORS HOLDING RING TO
SUPPORT RODS SHOULD HAVE
FLUSH MOUNTED FASTENERS
AND HAVE ALL CORNERS ROUNDED

ATTACH CORONA SHIELD TO
TOWER TOP PLATE AND
INSURE SOLID ELECTRICAL CONTACT

TOP VIEW

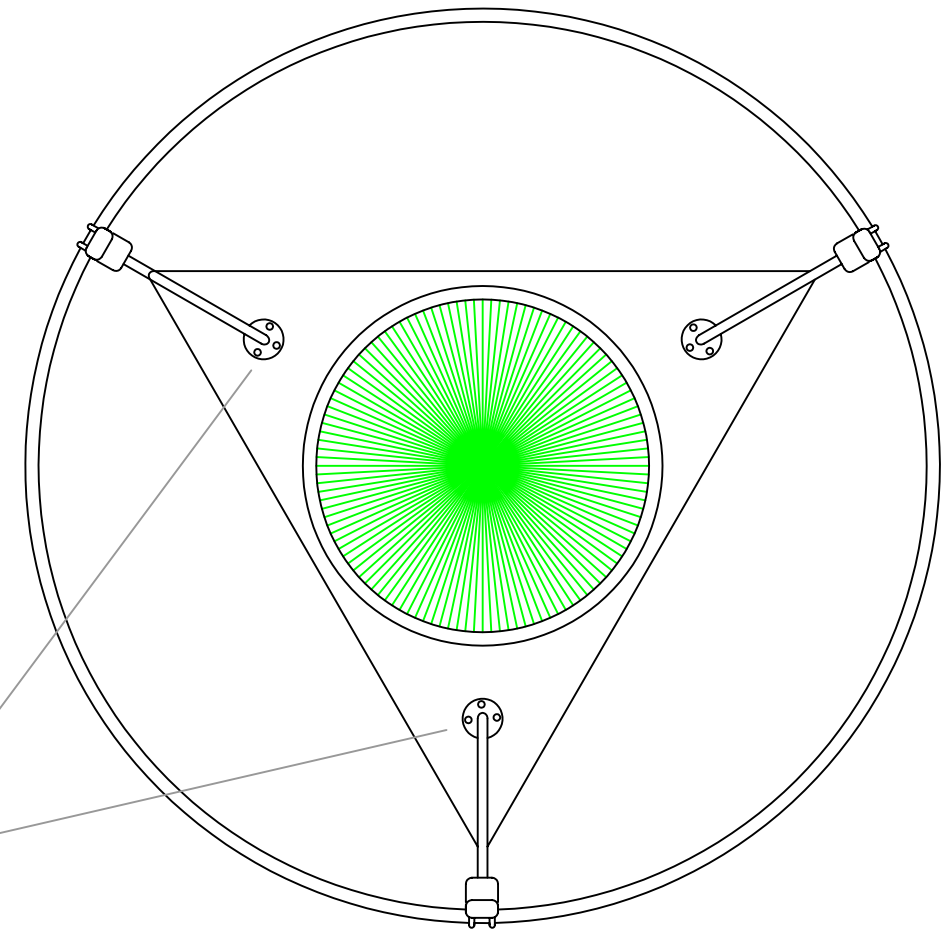

dTR / H&D
JOINT VENTURE

CORONA SHIELD FOR TOWER LIGHTING

DRAWING BY: BOB ALLEN
DATE: 3/2003

REVISION: 3/5/2002
3/19/2003
8/21/2003

DRAWING FILE:
coronashield2.dwg

PDF FILE:
coronashield2.pdf